



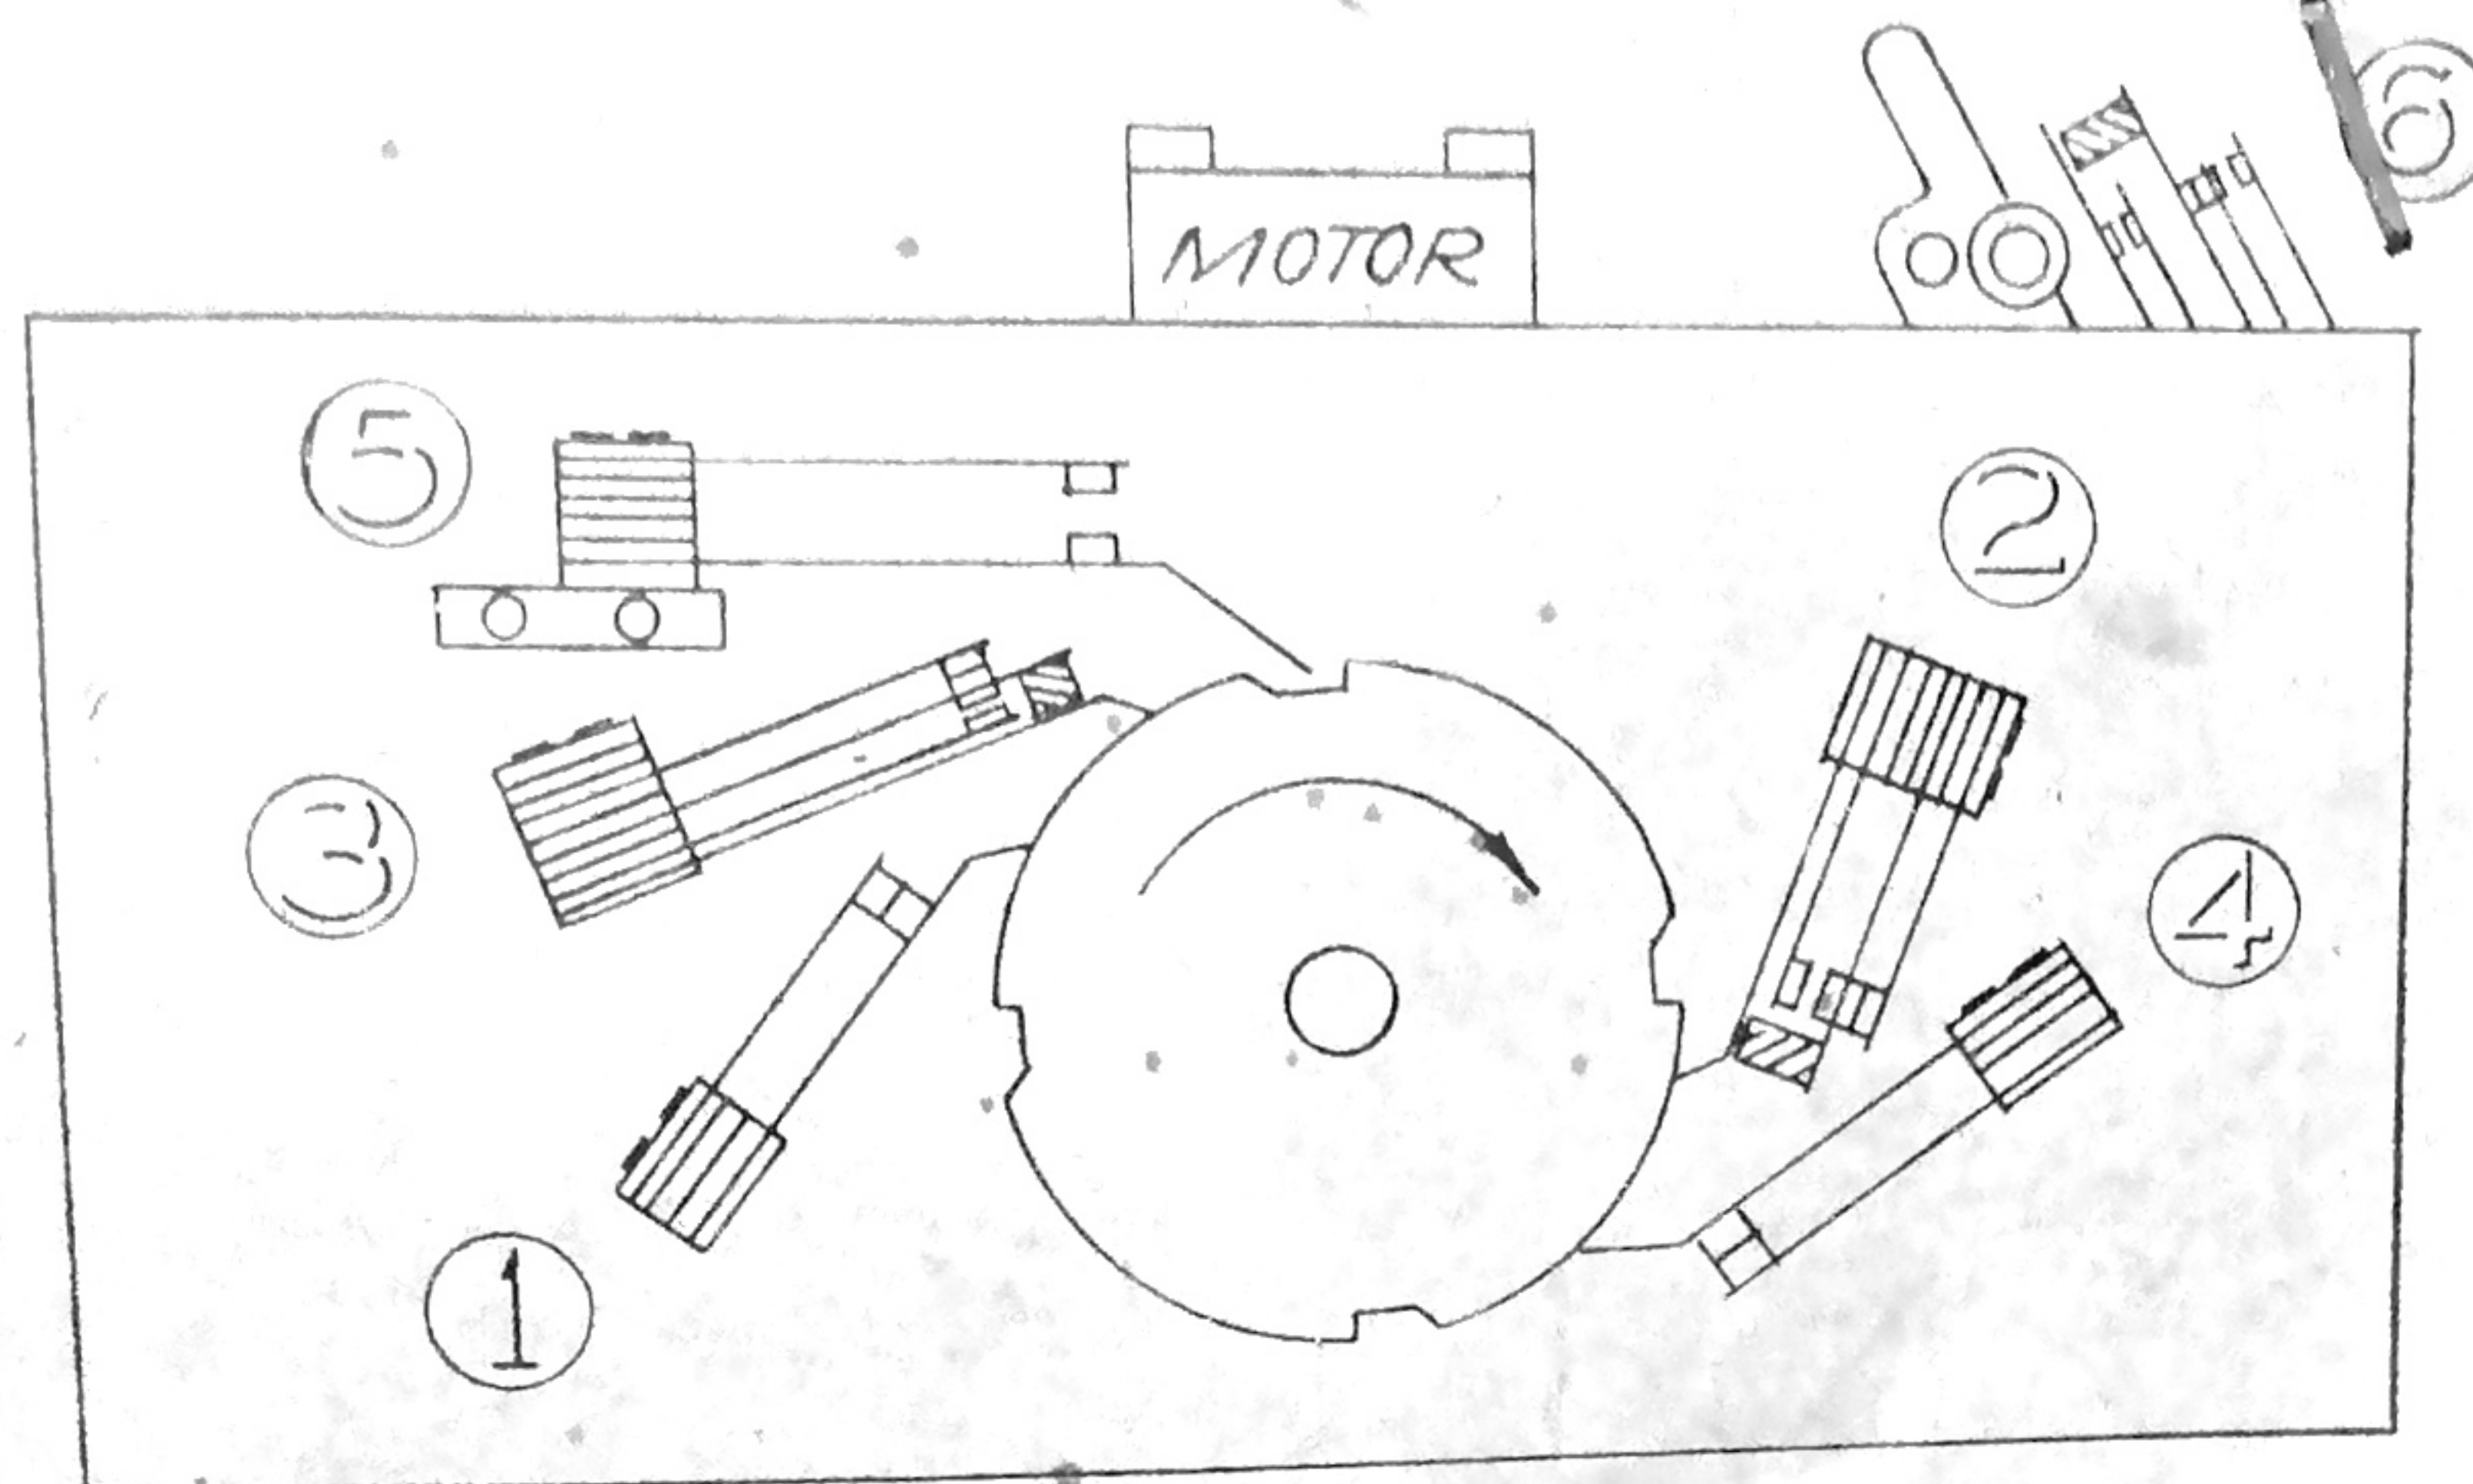

- No. 1 Switch opens circuit to double relay.
- No. 2 Switch opens circuit to triple relay and pulses match S.U.
Outside switch operates mixer unit
- No. 3 Switch opens circuit to home run relay and pulses match S.U.
- No. 4 Switch opens circuit to man loading coil.
- No. 5 Motor Running Switch
- No. 6 Loading Coil Switch
- No. 7 Motor Relay M-32-1800
- No. 8 No. 4 Relay M-32-1800
- No. 9 No. 3 Relay M-32-1800
- No. 10 No. 2 Relay M-32-1800

Switches No. 1, No. 2, No. 3, and No. 4 open in that order and each one must be closed before the next one opens.

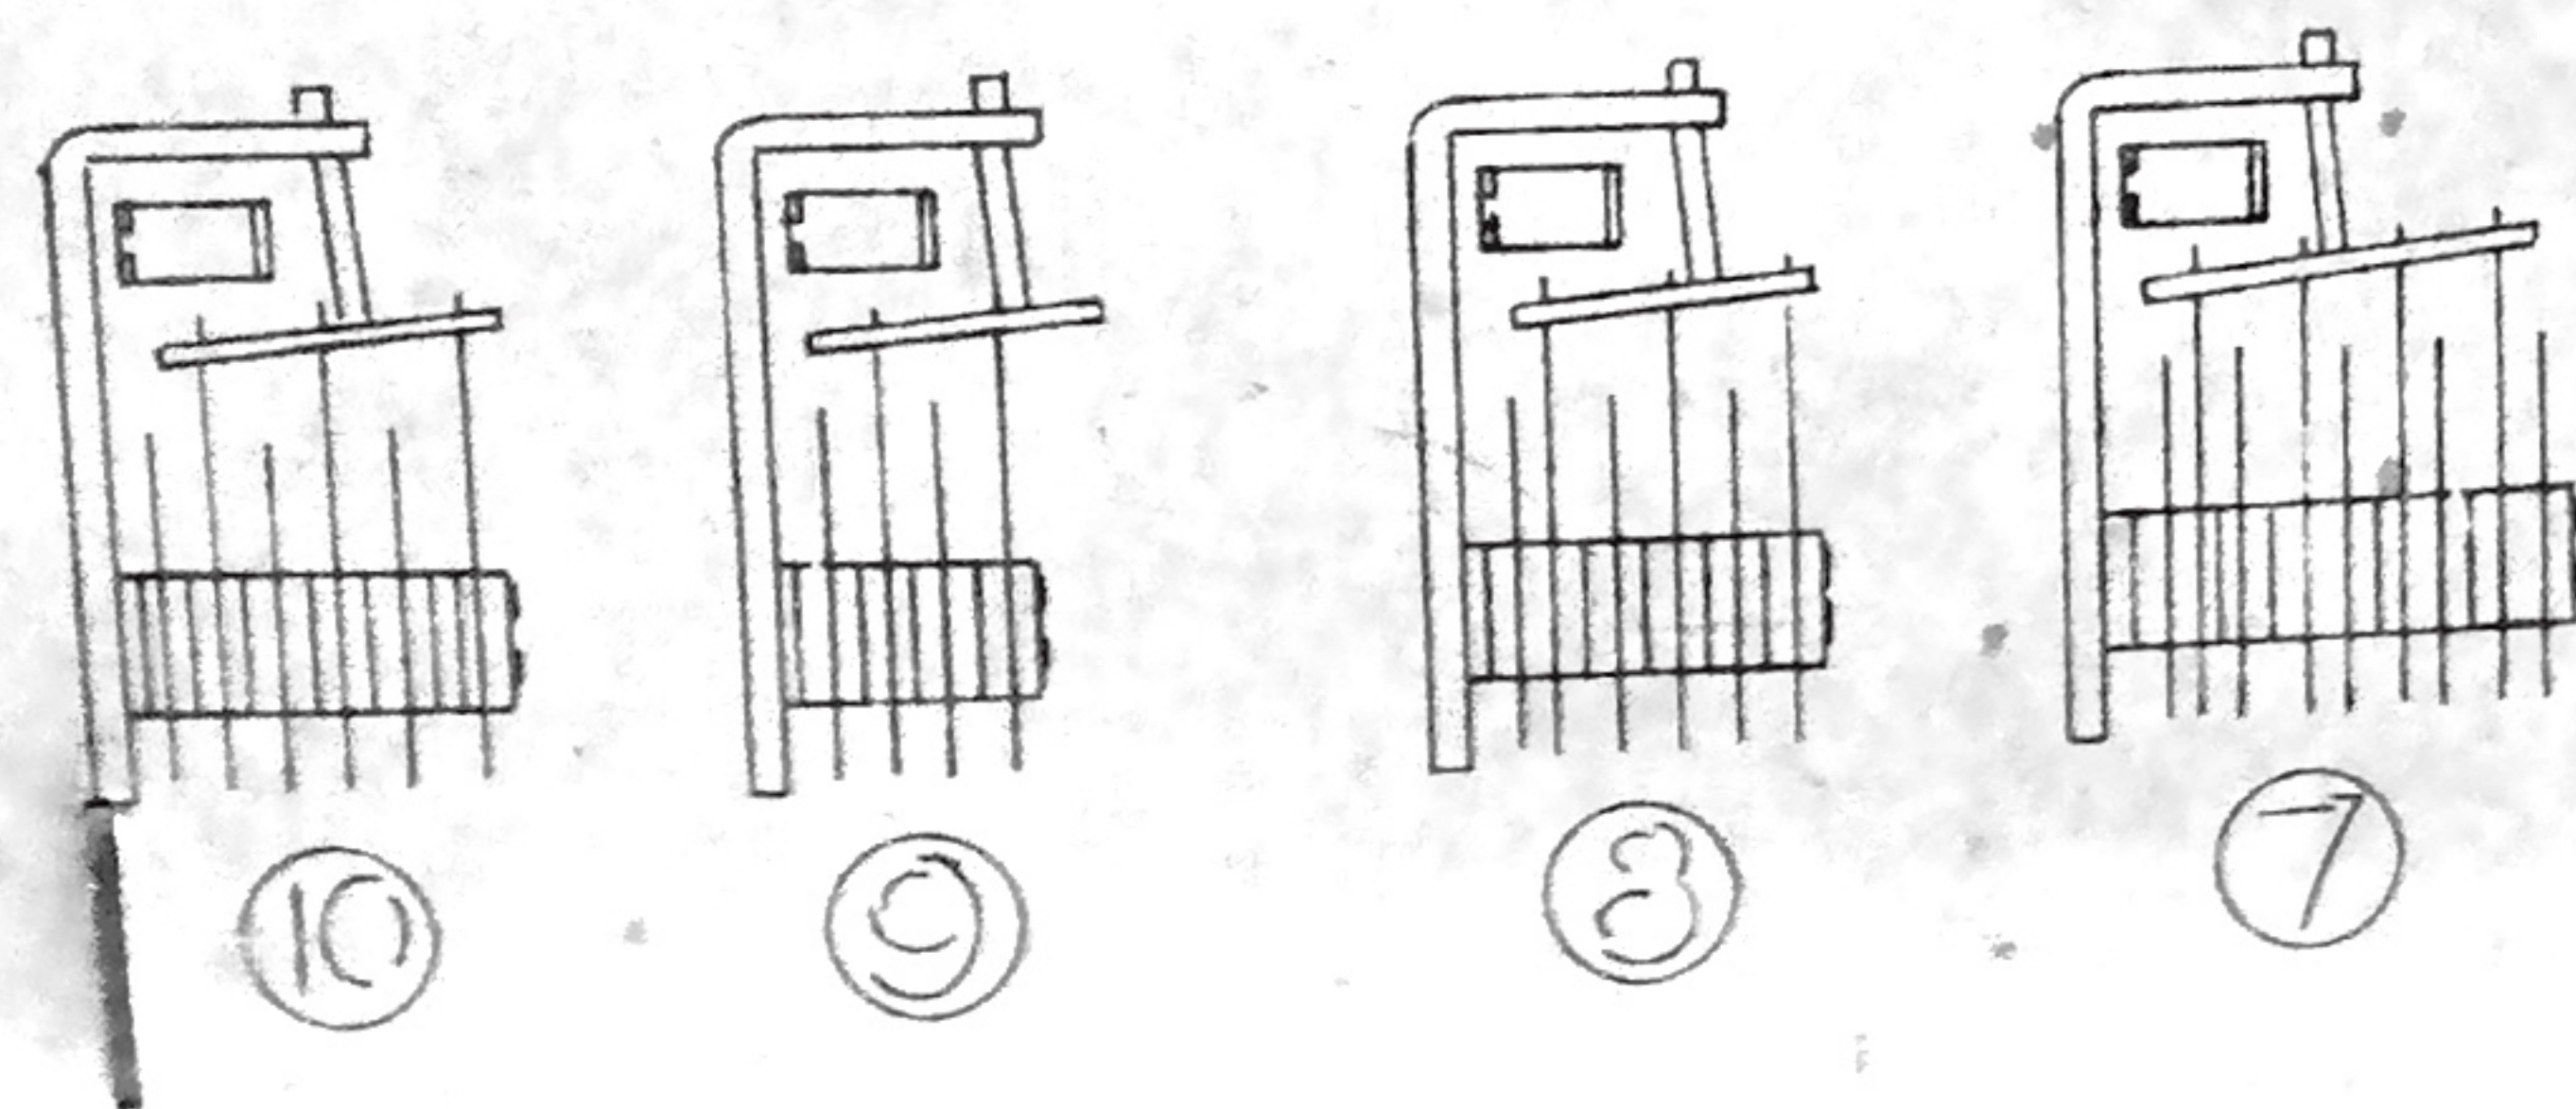

MAN RUNNING UNIT